

006260" 86504960

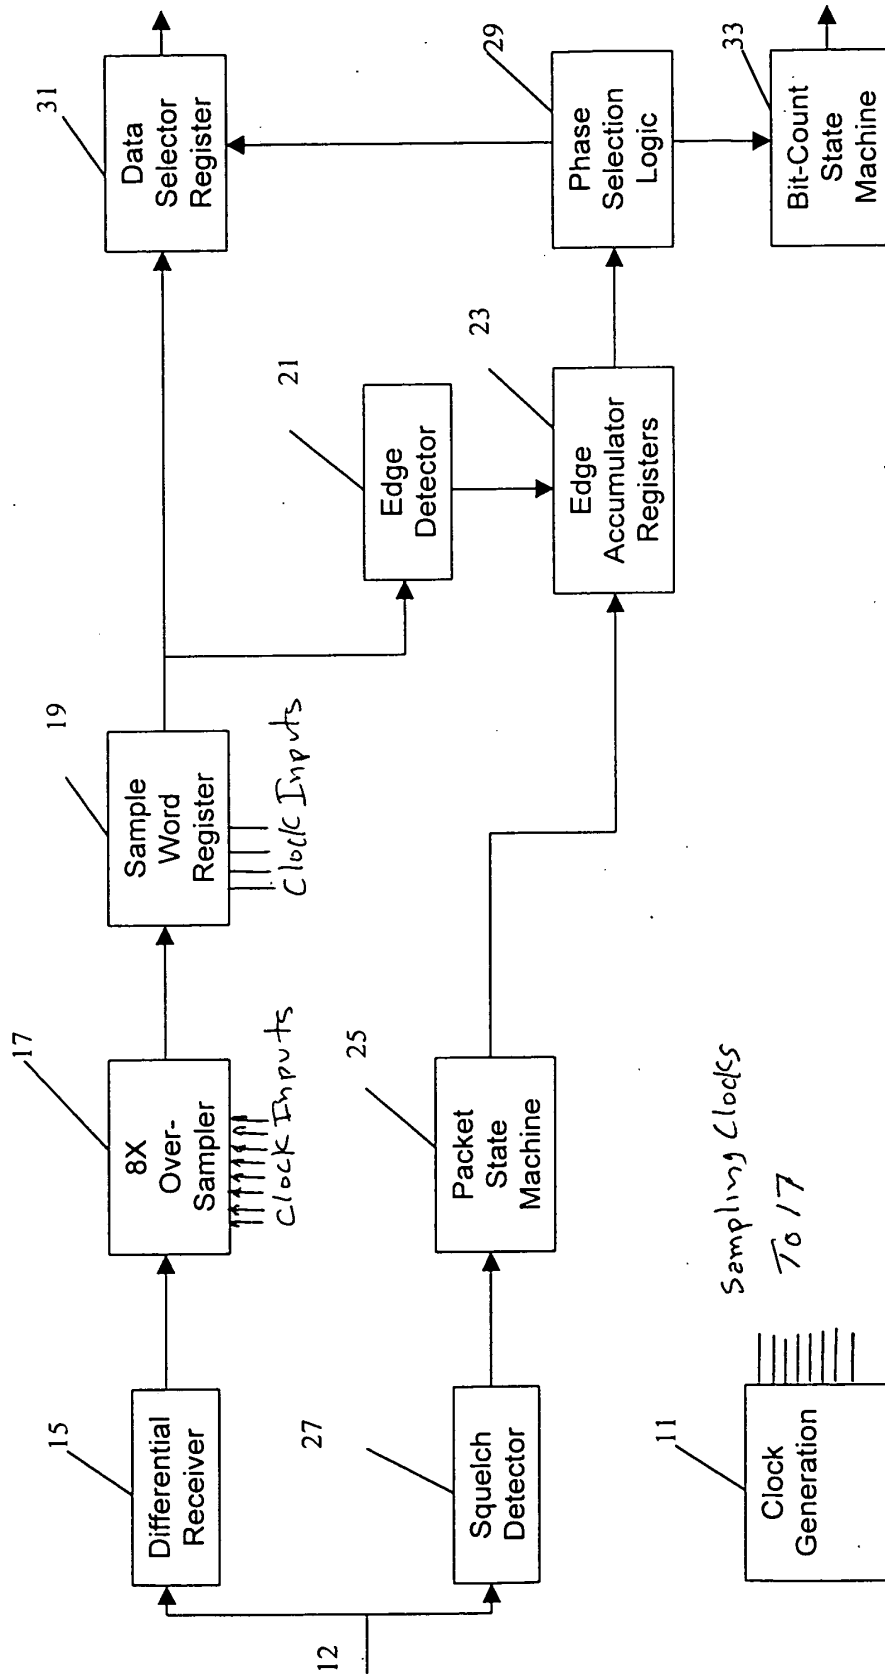


Fig. 1

To 19

Sampling Clocks

To 17

ck_{120}
 $ck_{120, delay 90}$
 $ck_{120, delay 180}$
 $ck_{120, delay 270}$

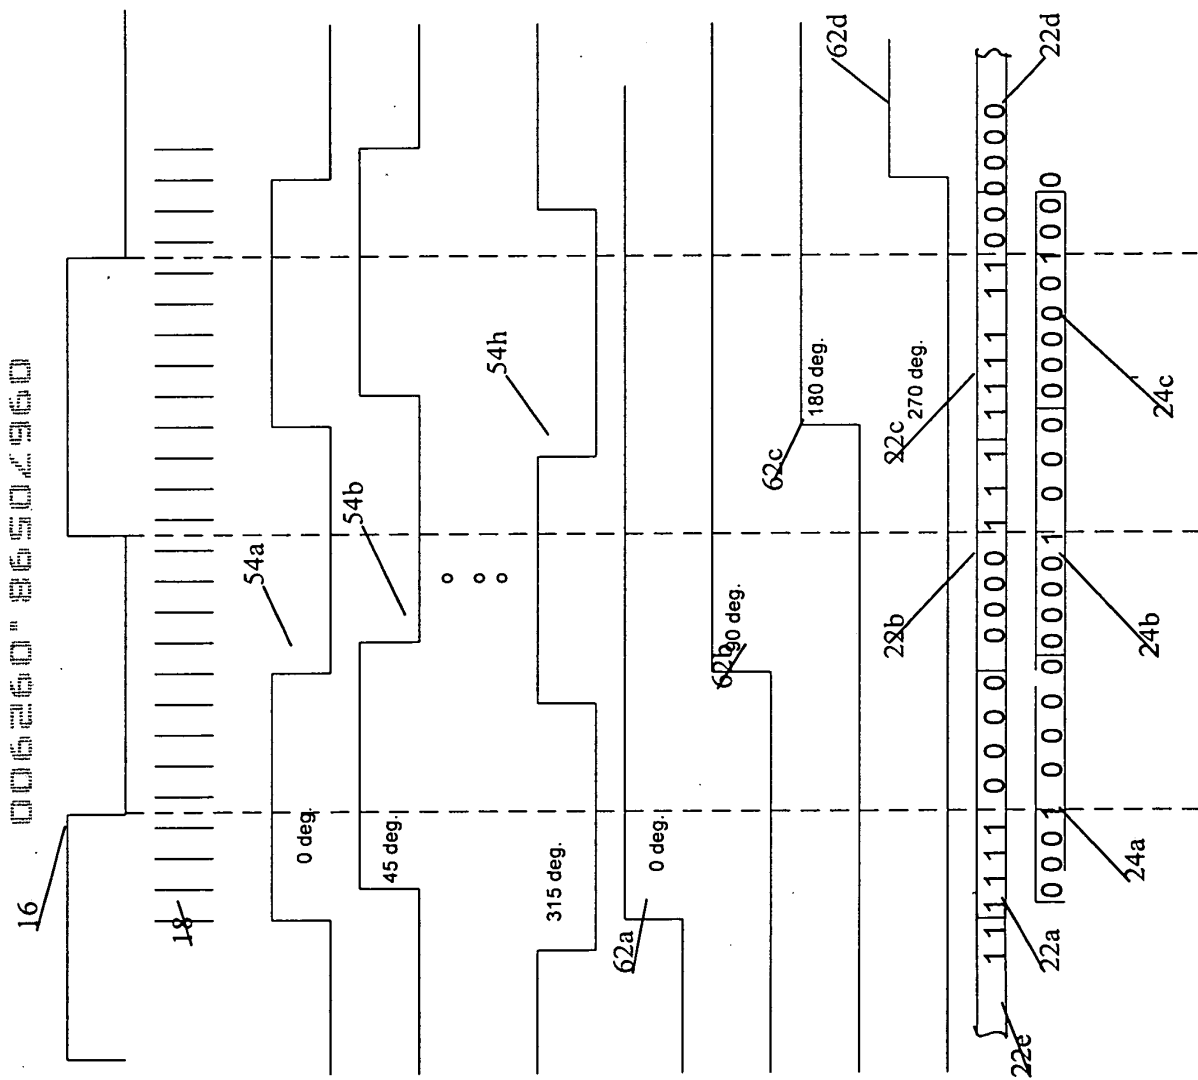


Fig. 2

006260" B6502960

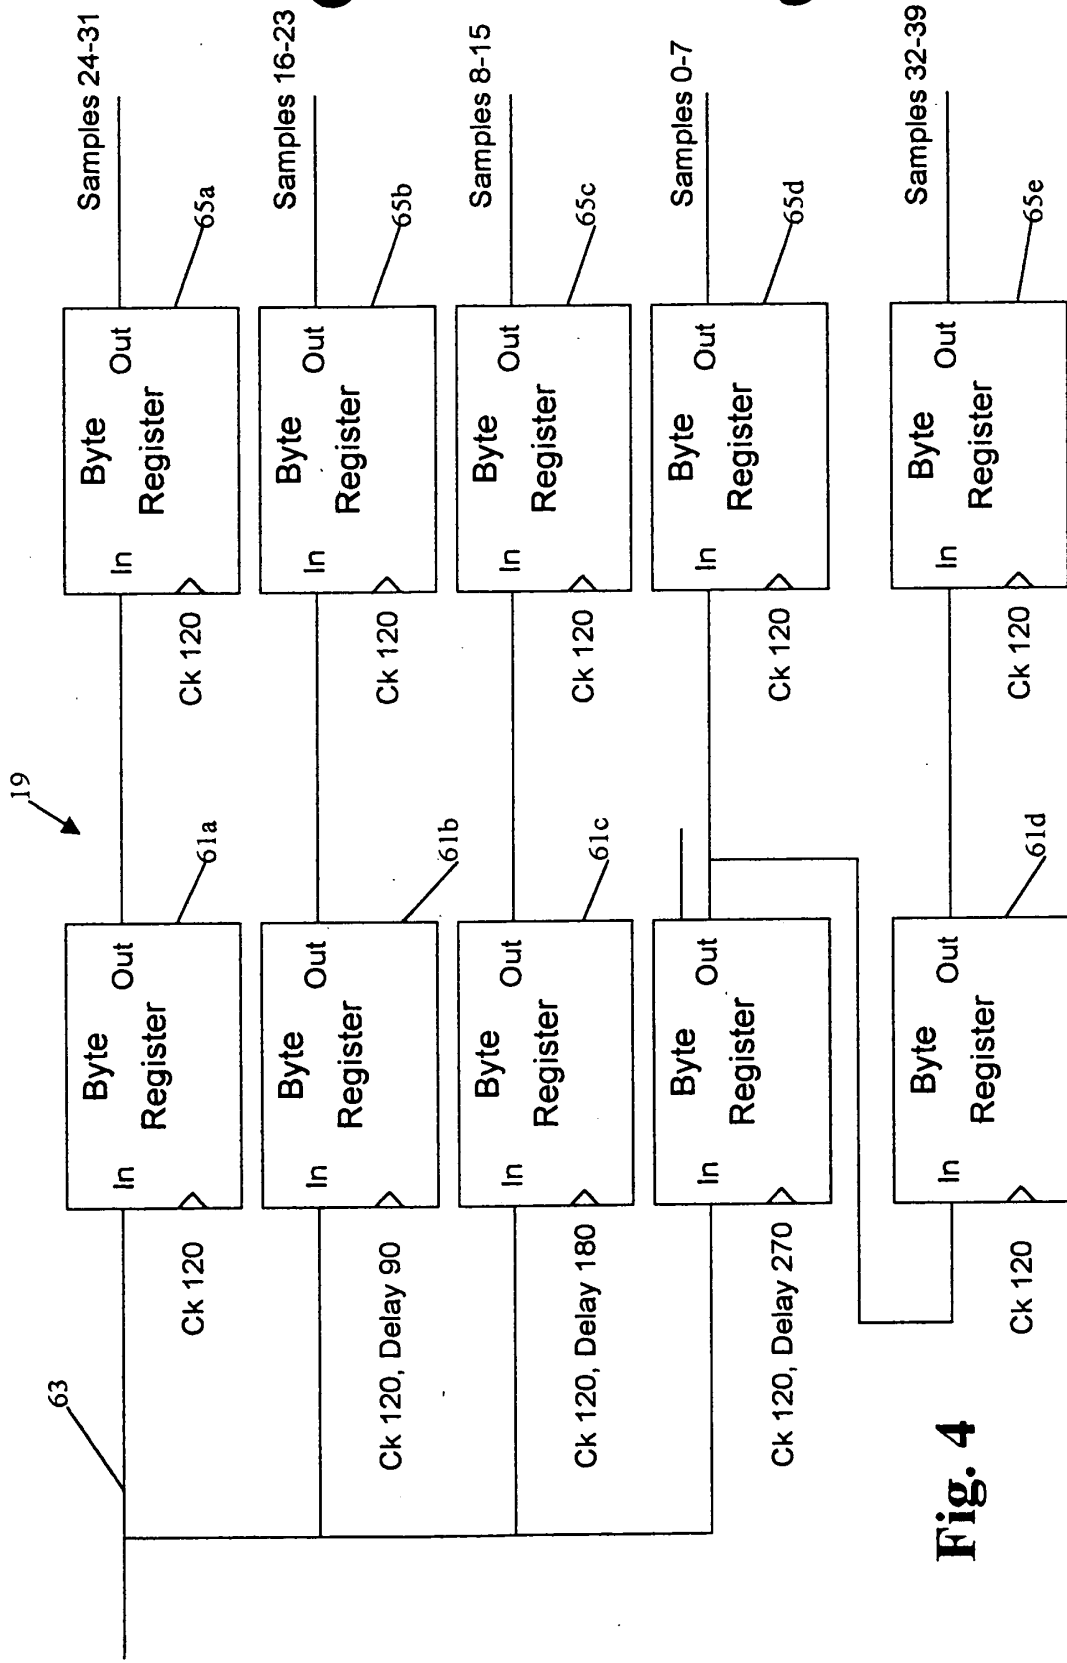


Fig. 4

006260" B6502950

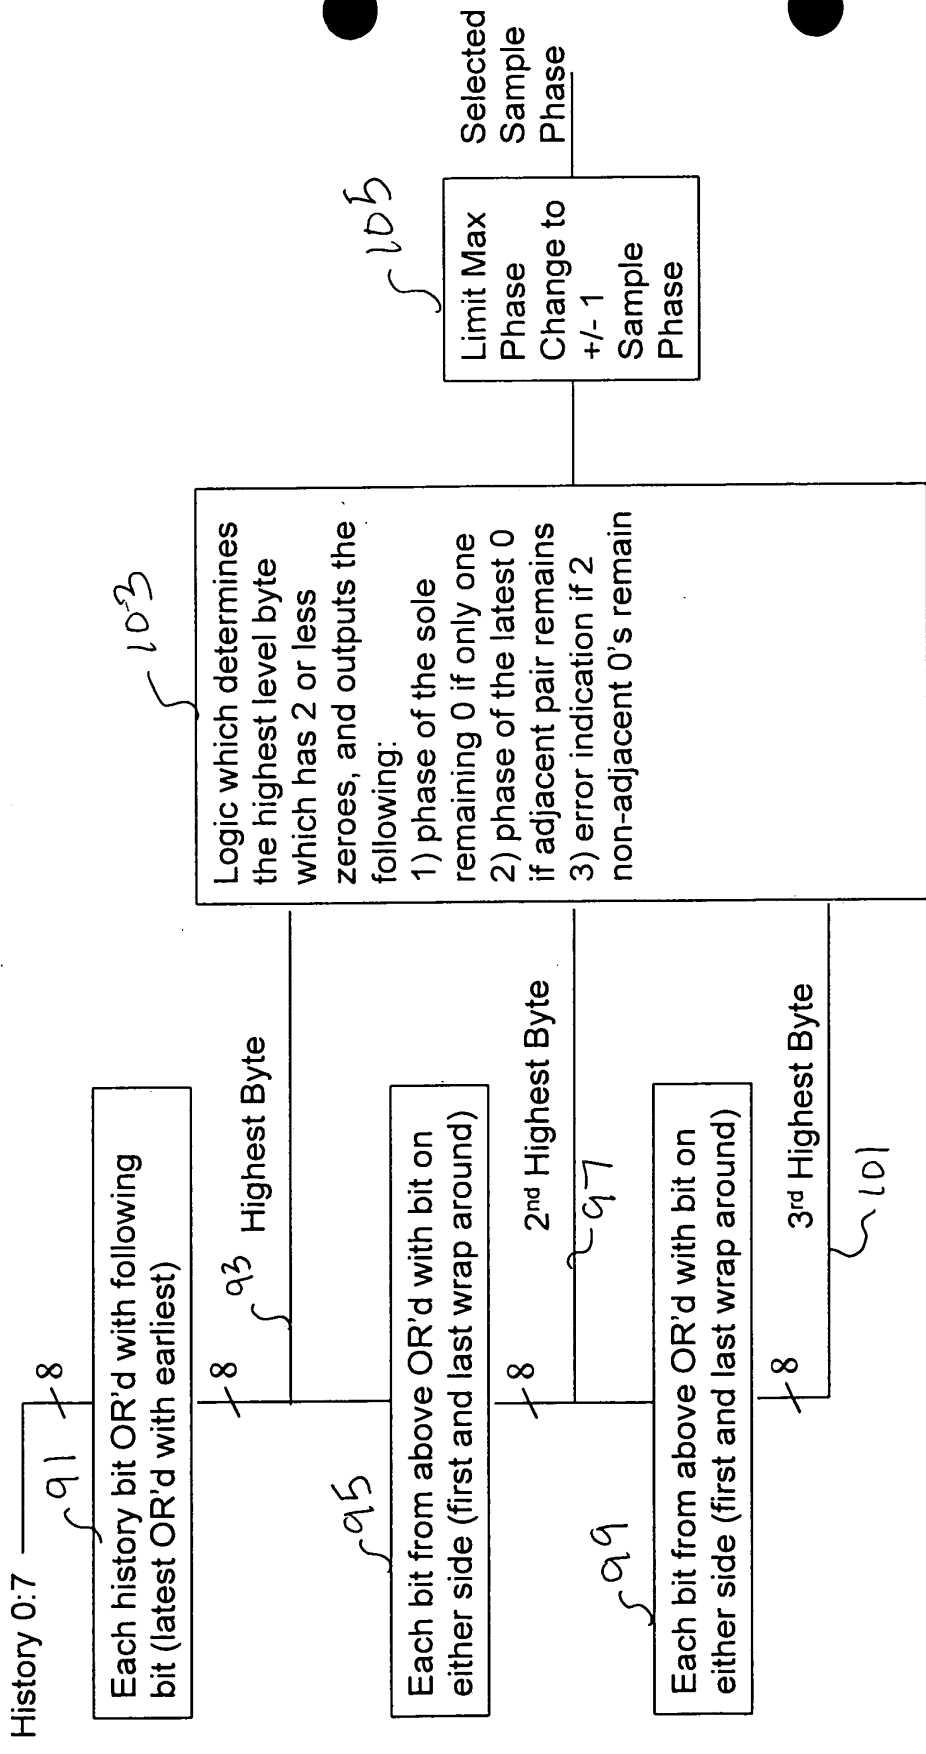


Fig. 7

Phase Selector